

Gateway Community Action Partnership

RIVER'S EDGE COMMUNITY CAMPUS
110 Cohansey Street, Bridgeton, NJ 08302
(856) 451-6330 • (856) 455-7288 FAX • www.gatewaycap.org

Dear Parents/Guardians:

The Gateway Early Head Start and Head Start Program is committed to protecting students' and staff's health. To protect our community and be in compliance with the Department of Education regulations for all schools in the State of New Jersey, all drinking water outlets at the center have been tested.

Testing is completed and you can see the results from the laboratory testing on page two.

Anything below 15.5 ppb is safe and all outlets at this site have tested well below the 15.5 ppb (parts per billion).


For additional information, refer to the Department of Environmental Protection's website at: <http://www.nj.gov/dep/watersupply/dwc-lead-schools.html>.

Sincerely,

Bonnie Eggenburg
Vice President and Director for Gateway Head Start and Early Head Start

Helping People • Changing Lives • Gateway to Success

"Our mission is to improve the quality of life and promote self-sufficiency."



South Jersey
Water Test, LLC
4077 South Black Horse Pike
Williamstown, NJ 08094
856-875-3506 Phone
856-875-3507 Fax

www.sjwatertest.com
NJ DEP Certified Lab #08006

Atlantic Cape Community College

5046 Black Horse Pike
Mays Landing, NJ 08330

Results of Lead Analysis

Date & Time First Draw Sampled: 12/20/2016 07:52 - 08:07

Date & Time Analyzed: 12/21/2016 16:15 - 16:51


Sample Location	First Draw	Action Level
ACC-2BAY-S Kitchen Sink	<2.00	15.5
ACC-WC Room 5 WC	<2.00	15.5
ACC-S Room 5 Sink	<2.00	15.5
ACC-S2 Room 5 Sink 2	<2.00	15.5
ACC-S Room 4 Sink	<2.00	15.5
ACC-S2 Room 4 Sink 2	<2.00	15.5
Field Reagent Blank (FRB)	<2.00	15.5

Units - ug/L = ppb


Action Level: The concentration of lead which determines whether some form of corrective action may be necessary.

QA/QC: Laboratory Fortified Blank (LFB) meets criteria of plus or minus 15% recovery.

Field Reagent Blank (FRB) concentration equals <2.00 ug/L.

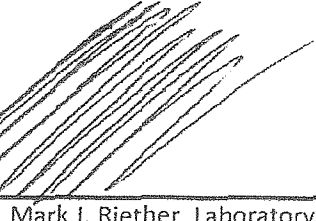
Mark J. Riether, Laboratory Director

1/4/17
Date



**South Jersey
Water Test, LLC**
4077 South Black Horse Pike
Williamstown, NJ 08094
856-875-3506 Phone
856-875-3507 Fax

www.sjwatertest.com
NJ DEP Certified Lab #08006

Atlantic Cape Community College Early Learning Center

5100 Black Horse Pike
Mays Landing, NJ 08330

Results of Lead Analysis

Date & Time First Draw Sampled: 12/18/2016 08:46 - 09:15

Date & Time Analyzed: 12/21/2016 12:59 - 14:23

Sample Location	First Draw	Action Level
Field Reagent Blank (FRB)	<2.00	15.5
ACCELC-S Room 1 Sink	<2.00	15.5
ACCELC-WC-H Hallway WC	<2.00	15.5
ACCELC-S-H #1 Sink	<2.00	15.5
ACCELC-S2-H #2 Sink	<2.00	15.5
ACCELC-S3-H #3 Sink	<2.00	15.5
ACCELC-S Room 2 Sink	<2.00	15.5
ACCELC-WC Room 2 WC	2.78	15.5
ACCELC-S Kitchen Sink	13.6	15.5
ACCELC-S Room 3 Sink	<2.00	15.5

Units - ug/L = ppb

Action Level: The concentration of lead which determines whether some form of corrective action may be necessary.

QA/QC: Laboratory Fortified Blank (LFB) meets criteria of plus or minus 15% recovery.

Field Reagent Blank (FRB) concentration equals <2.00 ug/L.

Mark J. Riether, Laboratory Director

1/4/17
Date